


Termination Clearances of Mechanical Draft and Direct-Vent Venting Systems

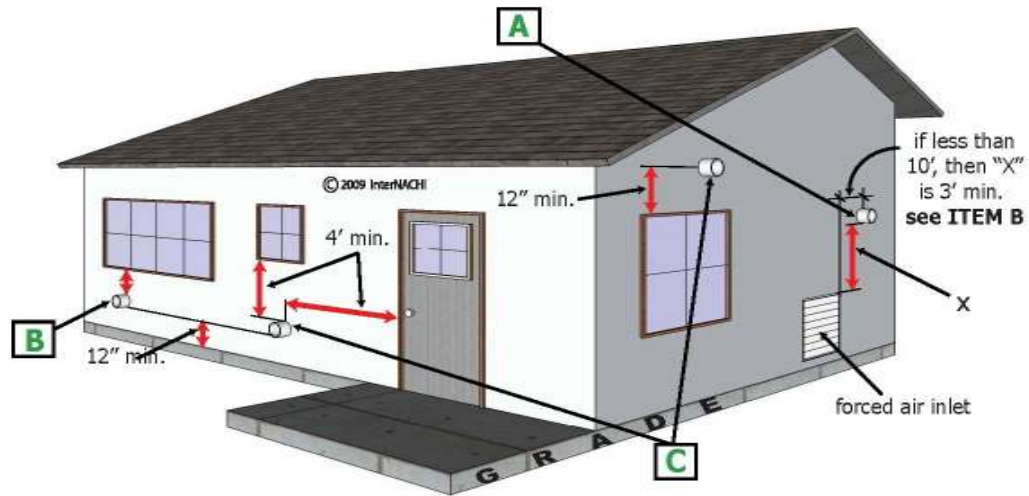

- ITEM A:** A mechanical draft venting system shall terminate at least 3 ft. above any forced-air inlet located within 10 ft.
- ITEM B:** The vent terminal of a direct-vent appliance with an input of 10,000 Btu/hr or less must be located at least 6" from any air opening into a building. If the input is over 10,000 Btu/hr but not over 50,000 Btu/hr, the vent termination must be located at least 9" from any air opening. If the input is over 50,000 Btu/hr the vent termination must be located at least 9" from any air opening. The bottom of the vent terminal and air intake must be at least 12" above grade.
- ITEM C:** Vent, excluding direct vent appliances, shall terminate at least 4 ft. below, 4 ft. horizontally from, or 1 ft. above any door, operable window, or gravity air inlet into any building. The bottom of the vent terminal shall be located at least 12 in. above grade.